



Stephenson

Environmental Management Australia

CO-GENERATION PLANT STACK EMISSION TESTING - 2018

TOOHEYS PTY LTD

LIDCOMBE, NSW

PROJECT NO.: 5938/S24635/18

DATE OF SURVEY: 12 MARCH 2018

DATE OF ISSUE: 29 MARCH 2018



Stephenson

Environmental Management Australia

Peter W Stephenson & Associates Pty Ltd
ACN 002 600 526 (Incorporated in NSW)
ABN 75 002 600 526

52A Hampstead Road
Auburn NSW 2144 Australia
Tel: (02) 9737 9991
e-mail: info@stephensonenv.com.au

CO-GENERATION PLANT STACK EMISSION TESTING - 2018

TOOHEYS PTY LTD

LIDCOMBE, NSW

PROJECT No.: 5938/S24635/18

DATE OF SURVEY: 12 MARCH 2018

DATE OF ISSUE: 29 MARCH 2018

P W STEPHENSON

J WEBER

TABLE OF CONTENTS

1	INTRODUCTION	1
2	PRODUCTION CONDITIONS.....	2
3	EMISSION TEST RESULTS AND DISCUSSION.....	3
3.1	INTRODUCTION	3
3.2	OXIDES OF NITROGEN (NO _x).....	3
3.3	VOLATILE ORGANIC COMPOUNDS	3
4	CONCLUSIONS.....	5
5	TEST METHODS	6
5.1	EXHAUST GAS VELOCITY AND TEMPERATURE	6
5.2	CONTINUOUS GASEOUS ANALYSIS	6
5.3	VOLATILE ORGANIC COMPOUNDS (VOCs)	6
5.4	MEASUREMENT OF UNCERTAINTY	6
	APPENDIX A – EMISSION TEST RESULTS	1
	APPENDIX B – CONTINUOUS LOGGED DATA.....	1
	APPENDIX C – NATA ENDORSED TEST REPORT	1
	APPENDIX D – PRODUCTION DATA.....	1
	APPENDIX E – INSTRUMENT CALIBRATION DETAILS.....	1
	APPENDIX F – STACK SAMPLING LOCATION	1

TABLE OF TABLES

TABLE 1-1	EPL ID No. 7 – EMISSION CONCENTRATION LIMITS AND MONITORING REQUIREMENTS.....	1
TABLE 3-1	SUMMARY OF AVERAGE EMISSION TEST RESULTS.....	4
TABLE 5-1	MEASUREMENT OF UNCERTAINTY.....	7

TABLE OF TABLES – APPENDICES

TABLE A-1	EMISSION TEST RESULTS – EPL ID No.7 – FLOW & VOCs.....	11
TABLE E-1	INSTRUMENT CALIBRATION DETAILS	11

TABLE OF FIGURES – APPENDICES

FIGURE B-1	CONTINUOUS LOG OF NITROGEN OXIDES EMISSIONS @ 5% O ₂ 12 MARCH 2017.....	11
FIGURE F-1	CO-GENERATION ENGINE STACK – EPA ID No. 7	11

1 INTRODUCTION

Stephenson Environmental Management Australia (SEMA) was requested by Tooheys Pty Ltd to assess emissions from the stack serving their Co-generation Plant at their brewing facility at Lidcombe, New South Wales (NSW).

Tooheys operates under the NSW Office of Environment and Heritage (OEH) EPL No. 1167. Condition L3.4 specifies the emission concentration limits for the stack serving the Co-generation Plant (EPA Identification (ID) No. 7). The objective of this monitoring is to meet the requirements for EPA ID No. 7 and to determine if the specified emission concentration limits are met.

The emission tests were undertaken on 12 March 2018.

TABLE 1-1 EPL ID NO. 7 – EMISSION CONCENTRATION LIMITS AND MONITORING REQUIREMENTS

Parameter	Units of measure	Frequency	OEH test method	100% conc. limit	Reference condition	Oxygen correction
Volatile Organic Compounds (as n-propane)	mg/m ³	Annual	TM-34	40	Dry, 273k, 101.3kPa,	5%
Nitrogen Oxides	mg/m ³	Annual	TM-11	250	Dry, 273k, 101.3kPa,	5%
Dry Gas Density	kg/m ³	Annual	TM-23	--	--	--
Moisture	%	Annual	TM-22	--	--	--
Molecular Weight	g/g mole	Annual	TM-23	--	--	--
Temperature	°C	Annual	TM-2	--	--	--
Volumetric Flow Rate	m/s	Annual	TM-2	--	--	--
Velocity	m ³ /s	Annual	TM-2	--	--	--

Key:

mg/m ³	=	milligrams per cubic metre
OEH	=	Office of Environment and Heritage
TM	=	Approved Test Method
mg/m ³	=	milligrams per cubic metre @ 0°C and 1 atmosphere
kg/m ³	=	kilograms per cubic metre
%	=	percent
g/g mole	=	grams per gram mole
°C	=	degrees Celsius
m/s	=	metres per second
m ³ /s	=	cubic metres per second
conc.	=	concentration
--	=	no specified limit

2 PRODUCTION CONDITIONS

On the day of testing, the plant operating procedures and production rate were considered typical by Tooheys personnel. Refer to Appendix D for Screen Shots of Co-generation engine operating conditions for the day of testing.

In essence, the Co-generation Engine and associated waste heat boiler was producing of the order of 2.0 megawatts (MW) of power and steam on the day of testing.

3 EMISSION TEST RESULTS AND DISCUSSION

3.1 INTRODUCTION

SEMA completed all the sampling and analysis for velocity, flow, dry gas density, molecular weight of stack gases, temperature, moisture, Volatile Organic Compounds (VOCs), Oxygen (O₂) and Nitrogen Oxides (NO_x). SEMA is NATA accredited to ISO 17025 to complete the sampling and analysis for the above parameters. SEMA NATA accreditation number is 15043.

The VOC sample, collected by SEMA, was analysed by the NATA accredited Testsafe Australia, accreditation number 3726, Report No. 2018-0996.

The emission test results are summarised in table format in Table 3-1. Sections 3.2 and 3.3 provide a description of the results.

Refer to Appendix B for a graphical logged record of NO_x continuous emission analysis.

Appendix C presents SEMA's NATA endorsed Emission Test Report, No. 5938.

Details of the most recent calibration of each instrument used to take measurements is summarised in Appendix E, and the sample location is illustrated in Appendix F.

3.2 OXIDES OF NITROGEN (NO_x)

The one-hour average NO_x (expressed as NO₂) emission concentration during the sampling period was 76 parts per million (ppm) and when corrected to 5% O₂ was 237 milligrams per cubic metre (mg/m³). This emission concentration was in compliance with the Co-generation EPL NO_x concentration limit of 250 mg/m³ at 5% O₂. Refer to Table 3-1 and Figure B-1 in Appendix B for detailed results in tabulated and graphical formats respectively.

3.3 VOLATILE ORGANIC COMPOUNDS

The sum of the total VOC emission concentrations in the suite of 73 analytes is reported as n-propane equivalent as required by the NSW OEH Approved Methods and POEO (Clean Air) Regulation 2010.

The measured total VOCs emission concentration as n-propane was less than 4.1 mg/m³ (less than 6.3 mg/m³ corrected to 5% O₂). Refer to Table 3-1 and Appendix C for details.

TABLE 3-1 SUMMARY OF AVERAGE EMISSION TEST RESULTS

Parameter	Unit of measure	EPL ID No.7 Average Result	EPL Concentration Limit
Temperature	°C	262	--
Pressure	kPa	101.8	--
Velocity	m/s	26.3	--
Volumetric Flow	m ³ /s	2.19	--
Moisture	%	10.4	--
Molecular Weight Dry Stack Gas	g/g mole	29.3	--
Gas Density	kg/m ³	1.31	--
Nitrogen Oxides	mg/m ³ @ 5% O ₂	237	250
Oxygen	%	10.4	--
Volatile Organic Compounds	mg/m ³ @ 5% O ₂ as n-propane equivalent	<6.3	40

Key:

EPL	=	Environment Protection Licence
°C	=	degrees Celsius
kPa	=	kilo Pascals
m/s	=	metres per second
m ³ /s	=	dry cubic metre per second 0°C and 101.3 kilopascals (kPa)
%	=	percentage
g/g mole	=	grams per gram mole
kg/m ³	=	kilograms per cubic metre
mg/m ³	=	milligrams per cubic metre at 0°C and 101.3 kilopascals (kPa)
<	=	less than

4 CONCLUSIONS

From the data presented and test work conducted during typical production, the following conclusions were drawn for the stack emissions:

- The one-hour average NO_x emission concentration, corrected to 5% O₂, was 237 mg/m³, which was in compliance with the EPL NO_x emission limit of 250 mg/m³.
- The VOC emission concentration corrected to 5% O₂ was <6.3 mg/m³, which was in compliance with the EPL VOC emission limit of 40 mg/m³ (expressed as n-propane).

5 TEST METHODS

5.1 EXHAUST GAS VELOCITY AND TEMPERATURE

(OEH NSW TM-1 & 2)

Velocity profiles were obtained across each stack utilising an Airflow Developments Ltd. S-type pitot tube and digital manometer. Where practicable, each sampling plane complied with AS4323.1. The temperature of the exhaust gas was measured using a digital thermometer (0-1200°C) connected to a chromel/alumel (K-type) thermocouple probe.

5.2 CONTINUOUS GASEOUS ANALYSIS

(OEH NSW TM-11, 24, 25 & 32)

Sampling and analysis of exhaust gas were performed using one of Stephenson Environmental Management Australia's mobile combustion and environmental monitoring laboratories. Emission gases were distributed to the analysers via a manifold. Flue gas from each stack was pumped continuously. The following components of the laboratory were relevant to this work:

Oxides of Nitrogen	Testo 350XL
Oxygen	Testo 350XL
Calibration	BOC / Air Liquide Special Gas Mixtures relevant for each analyser. Instrument calibrations were performed at the start and finish of sampling at each location.
QA/QC	Calibration (Zero/Span) checks Sample line integrity calibration check

5.3 VOLATILE ORGANIC COMPOUNDS (VOCs)

(OEH NSW TM-34)

A sample of stack air is drawn onto a carbon adsorption tube and analysed using Gas Chromatography/Mass Spectrometry (GC/MS) performed by the NATA accredited laboratory TestSafe Australia, accreditation number, 3726.

5.4 MEASUREMENT OF UNCERTAINTY

All results are quoted on a dry basis. SEMA has adopted the following (Table 5-1) uncertainties for various stack emission testing methods.

TABLE 5-1 MEASUREMENT OF UNCERTAINTY

Pollutant	Methods	Uncertainty
Moisture	AS4323.2, TM-22, USEPA 4	25%
Nitrogen Oxides	NSW TM-11, USEPA 7E	15%
Oxygen	NSW TM-24, USEPA 3A	1% actual
Velocity	AS4323.1, TM-2, USEPA 2	5%
Volatile Organic Compounds (adsorption tube)	TM-34, USEPA M18	25%

Key:

Unless otherwise indicated the uncertainties quoted have been determined @ 95% level of Confidence level (i.e. by multiplying the repeatability standard deviation by a co-efficient equal to 1.96) (Source - Measurement Uncertainty)

Sources: *Measurement Uncertainty - implications for the enforcement of emission limits by Maciek Lewandowski (Environment Agency) & Michael Woodfield (AEAT) UK*

Technical Guidance Note (Monitoring) M2 Monitoring of stack emissions to air Environment Agency Version 3.1 June 2005.

APPENDIX A – EMISSION TEST RESULTS

Glossary:

%	=	percent
°C	=	Degrees Celsius
am ³ /min	=	cubic metre of gas at actual conditions per minute
Normal Volume (m ³)	=	cubic metre at 0°C and 760 mm pressure and 1 atmosphere
am ³	=	cubic metre of gas at actual conditions
g/g mole	=	grams per gram mole
g/s	=	grams per second
hrs	=	hours
kg/m ³	=	kilograms per cubic metre
kPa	=	kilo Pascals
m ²	=	square metre
m/s	=	metre per second
m ³ /sec	=	cubic metre per second at 0°C and 1 atmosphere
mg	=	milligrams
mg/ m ³	=	milligrams per cubic metre at 0°C and 1 atmosphere
O ₂	=	Oxygen
SEMA	=	Stephenson Environmental Management Australia
VOC	=	Volatile Organic Compounds

Abbreviations of Personnel


PWS	=	Peter Stephenson
JW	=	Jay Weber

TABLE A-1 EMISSION TEST RESULTS – EPL ID No.7 – FLOW & VOCs

Emission Test Results	Flow & VOC's
Project Number	5938
Project Name	Tooheys
Test Location	EPA ID Point No.7 - Gas Engine
Date	12 March 2018
RUN	1
Sample Start Time (hrs)	10:50
Sample Finish Time (hrs)	12:05
Sample Location (Inlet/Exhaust)	Exhaust
Stack Temperature (°C)	262
Stack Cross-Sectional area (m ²)	0.181
Average Stack Gas Velocity (m/s)	26.3
Actual Gas Flow Volume (am ³ /min)	286
Total Normal Gas Flow Volume (m ³ /min)	131
Total Normal Gas Flow Volume (m ³ /sec)	2.19
Total Stack Pressure (kPa)	101.8
Moisture Content (% by volume)	10.4
Molecular Weight Dry Stack Gas (g/g-mole)	29.34
Dry Gas Density (kg/m ³)	1.31
Oxygen (%)	10.4
Carbon Dioxide (%)	5.8
Sampling Performed by	PWS, JW
Sample Analysed by (Laboratory)	SEMA
Calculations Entered by	JW
Calculations Checked by	PWS
Volatile Organic Compounds	
VOCs Sample Start Time:	11:01
VOCs Sample Finish Time:	12:01
Sampling Period (min):	60
SEMA Sample No.:	726863
Concentration (mg/m ³) @ 5% O ₂	<6.6
Concentration as n-propane equivalent (mg/m ³) @ 5% O ₂	<6.3

APPENDIX B – CONTINUOUS LOGGED DATA

FIGURE B-1 CONTINUOUS LOG OF NITROGEN OXIDES EMISSIONS @ 5% O₂ 12 MARCH 2017

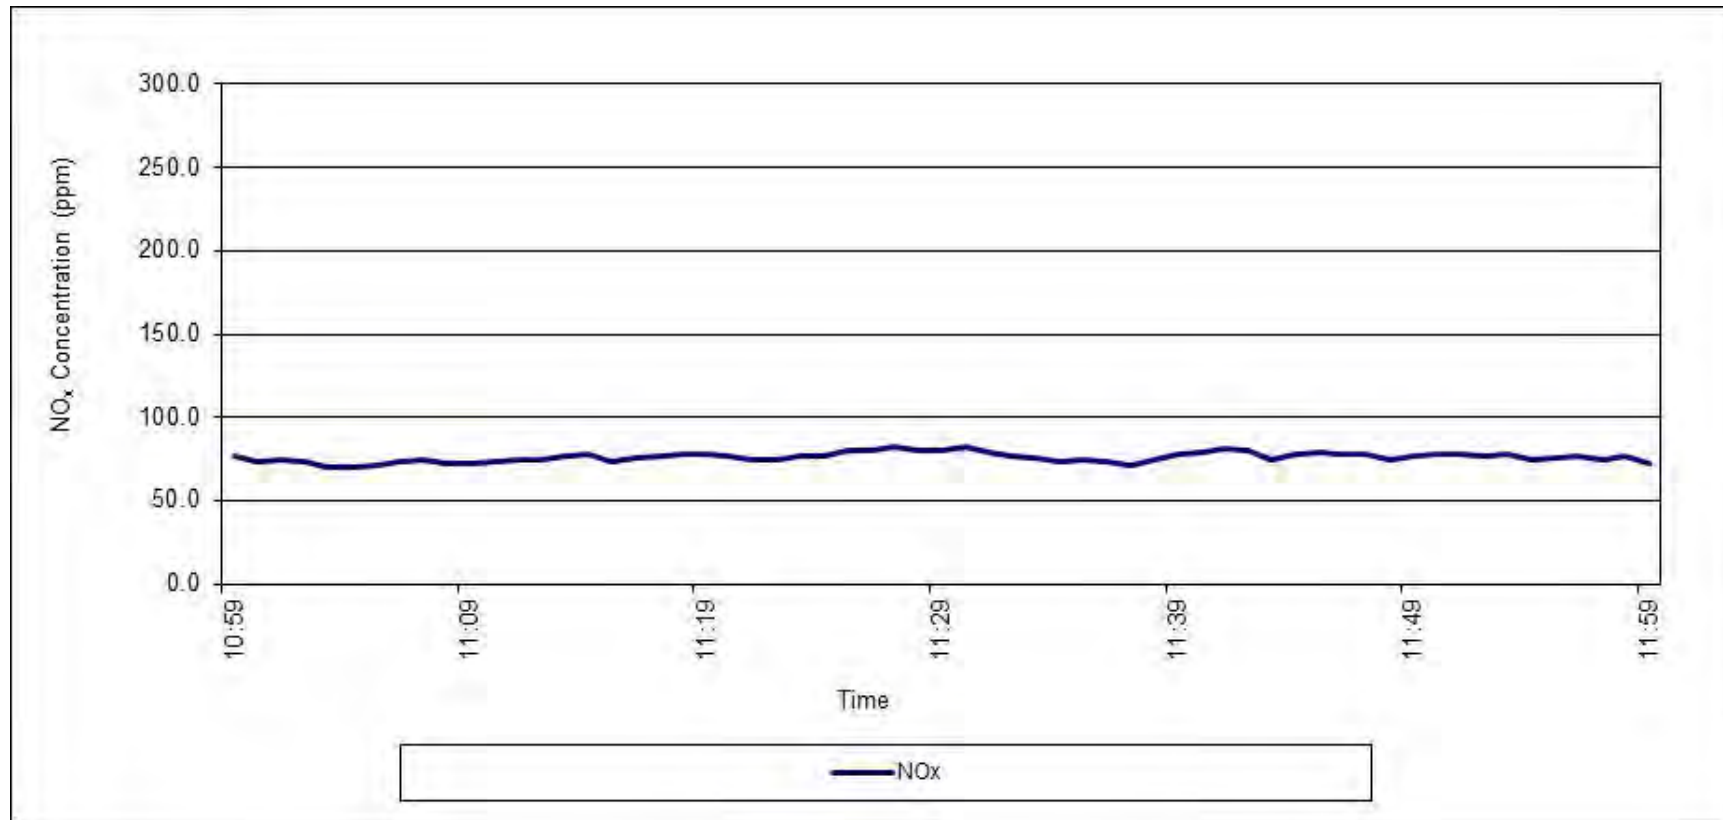

APPENDIX C – NATA ENDORSED TEST REPORT



Stephenson

Environmental Management Australia

Peter W Stephenson & Associates Pty Ltd
ACN 002 600 526 (Incorporated in NSW)
ABN 75 002 600 526

52A Hampstead Road
Auburn NSW 2144 Australia
Tel: (02) 9737 9991
E-Mail: info@stephensonenv.com.au

Emissions Test Report No. 5938

The sampling and analysis was commissioned by:

Client	Organisation:	Tooheys Pty Ltd
	Contact:	Paul Kiely
	Address:	29 Nyrang Street Lidcombe NSW 2141
	Telephone:	9647 9647
	Email:	paul.kiely@lionco.com
	Project Number:	5938/S24635/18
	Test Date:	12/03/2018
	Production Conditions:	Normal operating conditions during testing
	Analysis Requested:	Flow, temperature, moisture, Oxygen, Nitrogen Oxides, Dry Gas Density and Volatile Organic Compounds
	Sample Locations:	Co-Generation Engine Stack
	Sample ID Nos.:	See Attachment A

This report cannot be reproduced except in full.

NATA accredited laboratory number 15043.

Accredited for Compliance with ISO/IEC 17025.



Deviations from Test Methods	Nil
Sampling Times	NSW - As per Test Method requirements or if not specified in the Test Method then as per Protection of the Environment Operations (Clean Air) Regulations Part 2.
Reference Conditions	NSW - As per (1) Environment Protection Licence conditions, or (2) Part 3 of the Protection of the Environment Operations (Clean Air) Regulations

All associated NATA endorsed Test Reports/Certificates of Analysis are provided separately in Attachment A.

Issue Date
27 March 2018



P W Stephenson
Managing Director

ATTACHMENT A – NATA CERTIFICATES OF ANALYSIS



Jay Weber
Stephenson Environmental Management Australia
PO Box 6398
SILVERWATER NSW 1811

Lab. Reference: 2018-0996

SAMPLE ORIGIN: Project No. 5938

DATE OF INVESTIGATION: 12/03/2018

DATE RECEIVED: 14/03/18

ANALYSIS REQUIRED: Volatile Organic Compound Screen

REPORT OF ANALYSIS

See attached sheet(s) for sample description and test results.

The results of this report have been approved by the signatory whose signature appears below.

For all administrative or account details please contact the Laboratory.

Increment and total pagination can be seen on the following pages.

Martin Mazereeuw

Manager

Date: 22/03/18

TestSafe Australia – Chemical Analysis Branch
Level 2, Building 1, 9-15 Chilvers Road, Thornleigh, NSW 2120, Australia
T: +61 2 9473 4000 E: lab@safework.nsw.gov.au W: testsafe.com.au
ABN 81 913 830 179



Accreditation No. 3726

Accredited for compliance with ISO/IEC 17025



SafeWork NSW




Analysis of Volatile Organic Compounds in Workplace Air by GC/MS

Client : Jay Weber
Sample ID : 726863

Date Sampled : 12-Mar-2018
Reference Number : 2018-0996-1

No	Compounds	CAS No	Front	Back	No	Compounds	CAS No	Front	Back
			µg/section					µg/section	
Aliphatic hydrocarbons (LOQ = 5µg/compound/section)					Aromatic hydrocarbons (LOQ = 1µg/compound/section)				
1	2-Methylbutane	78-78-4	ND	ND	39	Benzene	71-43-2	ND	ND
2	n-Pentane	109-66-0	ND	ND	40	Ethylbenzene	100-41-4	ND	ND
3	2-Methylpentane	107-83-5	ND	ND	41	Isopropylbenzene	98-82-8	ND	ND
4	3-Methylpentane	96-14-0	ND	ND	42	1,2,3-Trimethylbenzene	526-73-8	ND	ND
5	Cyclopentane	287-92-3	ND	ND	43	1,2,4-Trimethylbenzene	95-63-6	ND	ND
6	Methylcyclopentane	96-37-7	ND	ND	44	1,3,5-Trimethylbenzene	108-67-8	ND	ND
7	2,3-Dimethylpentane	565-59-3	ND	ND	45	Styrene	100-42-5	ND	ND
8	n-Hexane	110-54-3	ND	ND	46	Toluene	108-88-3	ND	ND
9	3-Methylhexane	589-34-4	ND	ND	47	p-Xylene & /or m-Xylene	106-42-3 106-56-1	ND	ND
10	Cyclohexane	110-82-7	ND	ND	48	o-Xylene	95-47-6	ND	ND
11	Methylcyclohexane	108-87-2	ND	ND	Ketones (LOQ #49, #54 & #55 = 5µg/c/s; #50, #51, #52 & #53 = 25µg/c/s)				
12	2,2,4-Trimethylpentane	540-84-1	ND	ND	49	Acetone	67-64-1	ND	ND
13	n-Heptane	142-82-5	ND	ND	50	Acetoin	313-96-0	ND	ND
14	n-Octane	111-65-9	ND	ND	51	Diacetone alcohol	123-42-2	ND	ND
15	n-Nonane	111-84-2	ND	ND	52	Cyclohexanone	108-94-1	ND	ND
16	n-Decane	124-18-5	ND	ND	53	Isophorone	78-59-1	ND	ND
17	n-Undecane	1120-21-4	ND	ND	54	Methyl ethyl ketone (MEK)	78-93-3	ND	ND
18	n-Dodecane	112-40-3	ND	ND	55	Methyl isobutyl ketone (MIBK)	108-10-1	ND	ND
19	n-Tridecane	629-50-5	ND	ND	Alcohols (LOQ = 25µg/compound/section)				
20	n-Tetradecane	629-59-4	ND	ND	56	Ethyl alcohol	64-17-5	ND	ND
21	α-Pinene	80-56-8	ND	ND	57	n-Butyl alcohol	71-36-3	ND	ND
22	β-Pinene	127-91-3	ND	ND	58	Isobutyl alcohol	78-83-1	ND	ND
23	D-Limonene	138-86-3	ND	ND	59	Isopropyl alcohol	67-63-0	ND	ND
Chlorinated hydrocarbons (LOQ = 5µg/compound/section)					60	2-Ethyl hexanol	104-76-7	ND	ND
24	Dichloromethane	75-09-2	ND	ND	61	Cyclohexanol	108-93-0	ND	ND
25	1,1-Dichloroethane	75-34-3	ND	ND	Acetates (LOQ = 25µg/compound/section)				
26	1,2-Dichloroethane	107-06-2	ND	ND	62	Ethyl acetate	141-78-6	ND	ND
27	Chloroform	67-66-3	ND	ND	63	n-Propyl acetate	109-60-4	ND	ND
28	1,1,1-Trichloroethane	71-55-6	ND	ND	64	n-Butyl acetate	123-86-4	ND	ND
29	1,1,2-Trichloroethane	79-00-5	ND	ND	65	Isobutyl acetate	110-19-0	ND	ND
30	Trichloroethylene	79-01-6	ND	ND	Ethers (LOQ = 25µg/compound/section)				
31	Carbon tetrachloride	56-23-5	ND	ND	66	Ethyl ether	60-29-7	ND	ND
32	Perchloroethylene	127-18-4	ND	ND	67	tert-Butyl methyl ether (tBME)	1634-04-4	ND	ND
33	1,1,2,2-Tetrachloroethane	79-34-5	ND	ND	68	Tetrahydrofuran (THF)	109-99-9	ND	ND
34	Chlorobenzene	108-90-7	ND	ND	Glycols (LOQ = 25µg/compound/section)				
35	1,2-Dichlorobenzene	95-50-1	ND	ND	69	PGME	107-98-2	ND	ND
36	1,4-Dichlorobenzene	106-46-7	ND	ND	70	Ethylene glycol diethyl ether	629-14-1	ND	ND
Miscellaneous (LOQ #37= 5µg & #38=25µg/compound/section)					71	PGMEA	108-65-6	ND	ND
37	Acetonitrile	75-05-8	ND	ND	72	Cellosolve acetate	111-15-9	ND	ND
38	n-Vinyl-2-pyrrolidone	89-12-0	ND	ND	73	DGMEA	112-15-2	ND	ND
Total VOCs (LOQ = 50µg/compound/section)			ND	ND	Worksheet check			YES	YES

TestSafe Australia – Chemical Analysis Branch
ABN 81 913 830 179 Level 2, Building 1, 0-15 Chilvers Road, Thornleigh, NSW 2120, Australia
Telephone +61 2 9473 4000 Email lab@safework.nsw.gov.au Website testsafe.com.au



Accreditation No. 3726

Accredited for compliance with ISO/IEC 17025 - Testing



Analysis of Volatile Organic Compounds in Workplace Air by GC/MS

Client : Jay Weber
Sample ID : 726863

ND - Not Detected

Method : Analysis of Volatile Organic Compounds in Workplace Air by Gas Chromatography/Mass Spectrometry
Method Number : WCA.207
Limit of Quantitation : 5µg/section(25µg/section for oxygenated hydrocarbons except acetone, MEK and MIBK at 5µg/section.

Brief Description : Volatile organic compounds are trapped from the workplace air onto charcoal tubes by the use of a personal air monitoring pump. The volatile organic compounds are then desorbed from the charcoal in the laboratory with CS₂. An aliquot of the desorbant is analysed by capillary gas chromatography with mass spectrometry detection.

PGME : Propylene Glycol Monomethyl Ether
PGMEA : Propylene Glycol Monomethyl Ether Acetate
DGMEA : Diethylene Glycol Monoethyl Ether Acetate

Measurement Uncertainty
The measurement uncertainty is an estimate that characterises the range of values within which the true value is asserted to lie. The uncertainty estimate is an expanded uncertainty using a coverage factor of 2, which gives a level of confidence of approximately 95%. The estimate is compliant with the "ISO Guide to the Expression of Uncertainty in Measurement" and is a full estimate based on in-house method validation and quality control data.

Quality Assurance
In order to ensure the highest degree of accuracy and precision in our analytical results, we undertake extensive intra- and inter-laboratory quality assurance (QA) activities. Within our own laboratory, we analyse laboratory and field blanks and perform duplicate and repeat analysis of samples. Spiked QA samples are also included routinely in each run to ensure the accuracy of the analyses. WorkCover Laboratory Services has participated for many years in several national and international inter-laboratory comparison programs listed below:-

- Workplace Analysis Scheme for Proficiency (WASP) conducted by the Health & Safety Executive UK;
- Quality Management in Occupational and Environmental Medicine QA Program, conducted by the Institute for Occupational, Social and Environmental Medicine, University of Erlangen - Nuremberg, Germany;
- Quality Control Technologies QA Program, Australia;
- Royal College of Pathologists QA Program, Australia.



APPENDIX D – PRODUCTION DATA

Screenshot

12/06/2010 - 2nd eng 09/2014
PLC-date = 12.03.2018 12:18:41

PLC release = 2.29.43
Comment: Toohey's

Number of faults = 0
Number of alarms = 1
Operation hours = 43130

Number: 9296876
Engine type: TCG2020V20

Actual load = 1918 kW
Actual speed = 1498.9 1/min
Starts = 2645



Data

- Speed, power
- Operation mode
- E196.7 Demand active
- E196.3 Internal set power
- Power switch
- E196.6 Power limit
- E196.4 Set power
- E196.2 Actual power
- S200 Engine speed
- Throttle valve
- Gas rail
- AI and gas pressure A
- Chosen gas type
- Dual gas state
- CH4 value

Cyl. chamber	Side A	Side B	Mains
Cylinder 1	269 °C	305 °C	95.3 %
Cylinder 2	300 °C	309 °C	94.5 %
Cylinder 3	276 °C	359 °C	
Cylinder 4	296 °C	317 °C	
Cylinder 5	314 °C	326 °C	94.6 %
Cylinder 6	291 °C	313 °C	94.6 %
Cylinder 7	323 °C	404 °C	94.5 %
Cylinder 8	320 °C	333 °C	1498.9 1/min
Cylinder 9	454 °C	347 °C	64.4 %
Cylinder 10	347 °C	321 °C	64.4 %
Cold junction	52.3 °C	58.0 °C	
Average value	318 °C		
Set value	319 °C		
Gas mixer	-241 Steps		
Active start	800 Steps		
CH4 value			

Overview

Engine

Heating/cooling circuits

Gas/mixture

Air/Generator

Wastogate

Data/counted measurands

Operating information

Screenshot

1 **Auto** **Load run** 12.03.2018 06:53:57 **1918 kW** 1498.9 1/min **0** **1** **Exxx Earth leakage monitor control switchi...** 12.11.1998 07:09:33 Appears **12.03.2018** 13:18:41

Screenshot


12/06/2010 - 2nd eng 09/2014
PLC-date = 12.03.2018 12:21:32

PLC release = 2.29.43
Comment: Toohey's

Number of faults = 0
Number of alarms = 1
Operation hours = 43130

Number: 9296876
Engine type: TCG2020V20

Actual load = 1906 kW
Actual speed = 1497.9 1/min
Starts = 2645

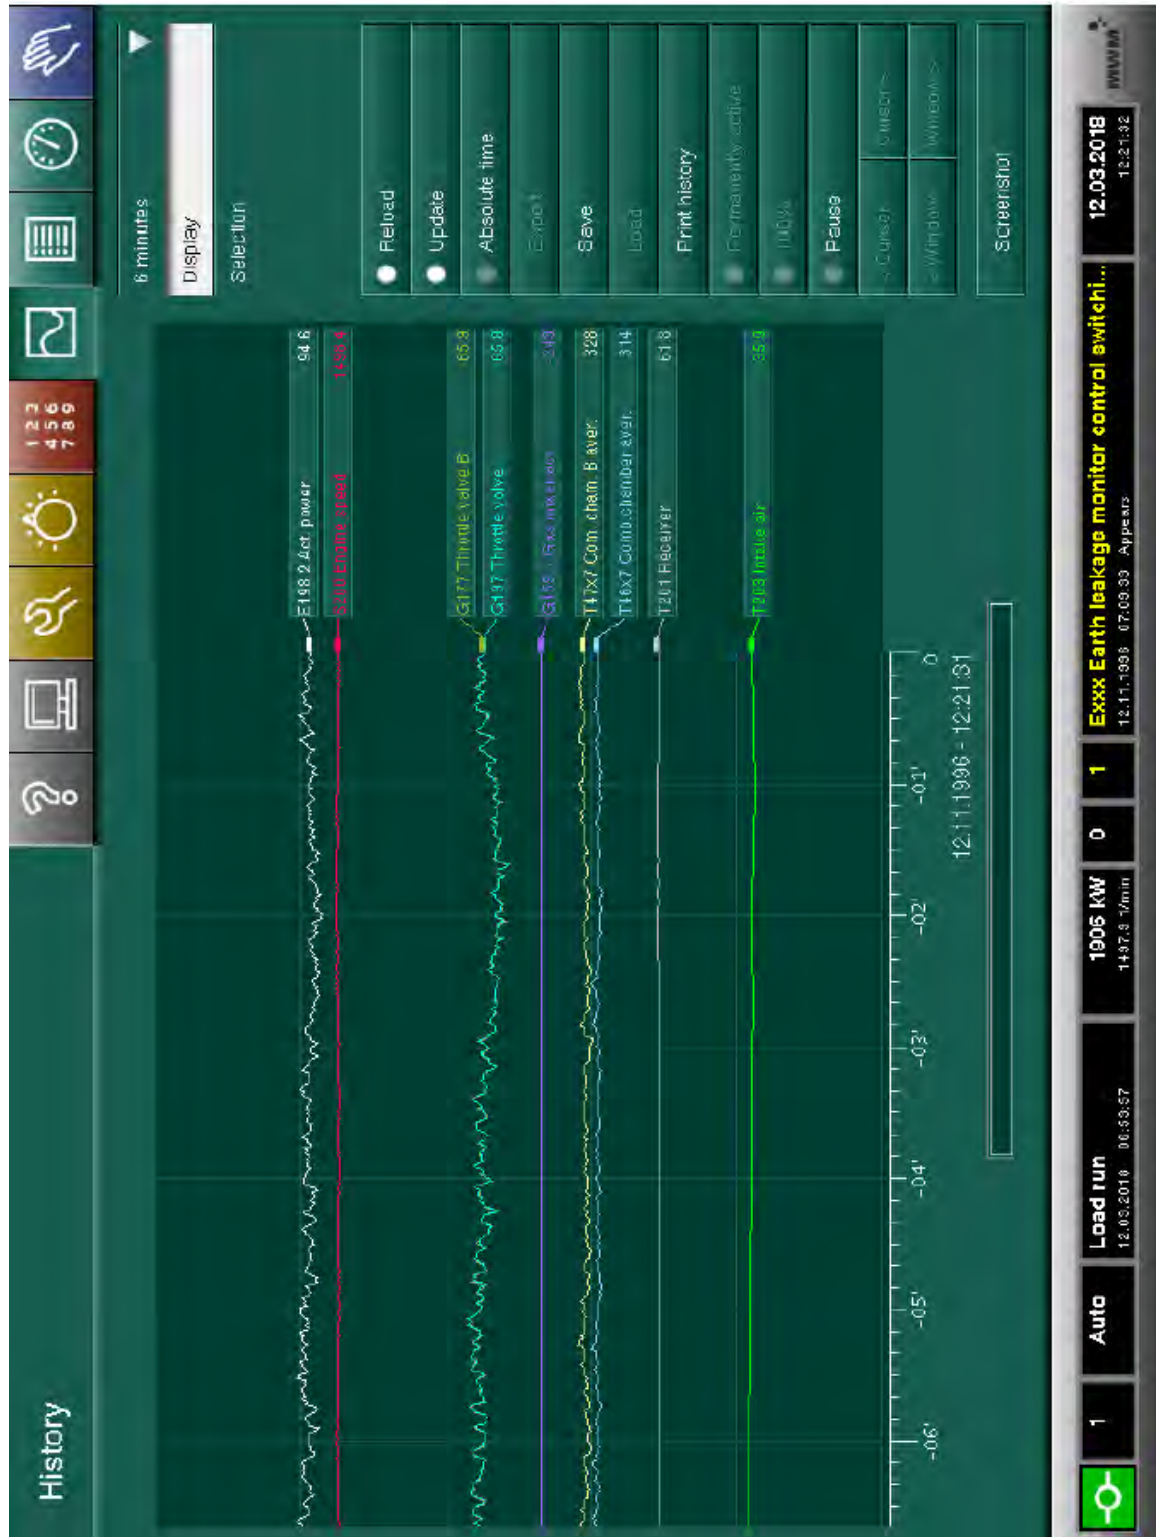

Screenshot

12/06/2010 - 2nd eng 09/2014
PLC-date = 12.03.2018 12:17:06

PLC release = 2.29.43
Comment: Toohey's

Number: 9296876
Engine type: TCG2020V20

Number of faults = 0
Number of alarms = 1
Operation hours = 43130

Actual load = 1928 kW
Actual speed = 1499.4 1/min
Starts = 2645



Data

Speed, power
Operation mode
E196.7 Demand active
E196.3 Internal set power
Power switch
E196.6 Power limit
E196.4 Set power
E196.2 Actual power
S200 Engine speed
Throttle valve

Cylinder	Side A	Side B
Cylinder 1	268 °C	300 °C
Cylinder 2	296 °C	311 °C
Cylinder 3	276 °C	338 °C
Cylinder 4	302 °C	326 °C
Cylinder 5	308 °C	331 °C
Cylinder 6	294 °C	315 °C
Cylinder 7	319 °C	355 °C
Cylinder 8	323 °C	328 °C
Cylinder 9	359 °C	340 °C
Cylinder 10	354 °C	317 °C

Average value: 318 °C
Gas mixer: -243 Steps

Mains: 95.3%
94.0%

Lube oil
T208 Lube oil: 96.0 °C
F196 Lube oil before filter: 4.71 bar
L234 1 Lube oil level: 102.8%
Exhaust gas
Exhaust after ATL: 431 °C
430 °C

Measured values

Intake air	35.8 °C
Receiver	61.8 °C
T202 Jacket water GK inlet	41.8 °C
T207 Jacket water engine inlet	81.0 °C
T206 Jacket water engine outlet	93.4 °C
F145 Crankcase	2.6 mbar

Overview

Engine
Heating/cooling circuits
Gas/mixture
Air/Generator
Wastogate
Data/collected measurements
Operating information

1928 kW 1499.4 1/min
Auto Load run 12.03.2018 06:53:57
1 **0** **1** **Exxx Earth leakage monitor control switchi...** 12.11.1938 07:09:33 Appears
12.03.2018 13:17:06


APPENDIX E – INSTRUMENT CALIBRATION DETAILS

TABLE E-1 INSTRUMENT CALIBRATION DETAILS

SEMA Asset No.	Equipment Description	Date Last Calibrated	Calibration Due Date
645	Stopwatch	16-Jan-18	16-Jul-18
858	Digital Temperature Reader	16-Jan-18	16-Jul-18
720	Thermocouple	05-Feb-18	05-Aug-18
613	Barometer	05-Feb-18	05-Feb-19
726	Pitot	03-Jun-17	03-Jun-2018 Visually inspected On-Site before use
929	Calibrated Site Mass	22-Mar-17	22-Mar-18
928	Balance		Response Check with SEMA Site Mass
946	combustion analyzer	05-Feb-18	05-Aug-18
932	Personal Sampler	28-Sep-17	28-Sep-18
Gas Mixtures used for Analyser Span Response			
Conc.	Mixture	Cylinder No.	Expiry Date
262 ppm 263 ppm 249 ppm	Nitric Oxide Total Oxide Of Nitrogen In Nitrogen Sulphur Dioxide In Nitrogen	ALWB 4441	23-Jun-21
0.099% 9.8% 10.1%	Carbon Monoxide Carbon Dioxide Oxygen In Nitrogen	ALWB 5361	17-Jul-21
400 ppm 400 ppm 401 ppm	Nitric Oxide Total Oxide Of Nitrogen In Nitrogen Sulphur Dioxide In Nitrogen	ALWB6150	05-May-20

APPENDIX F – STACK SAMPLING LOCATION

FIGURE F-1 CO-GENERATION ENGINE STACK – EPA ID NO. 7

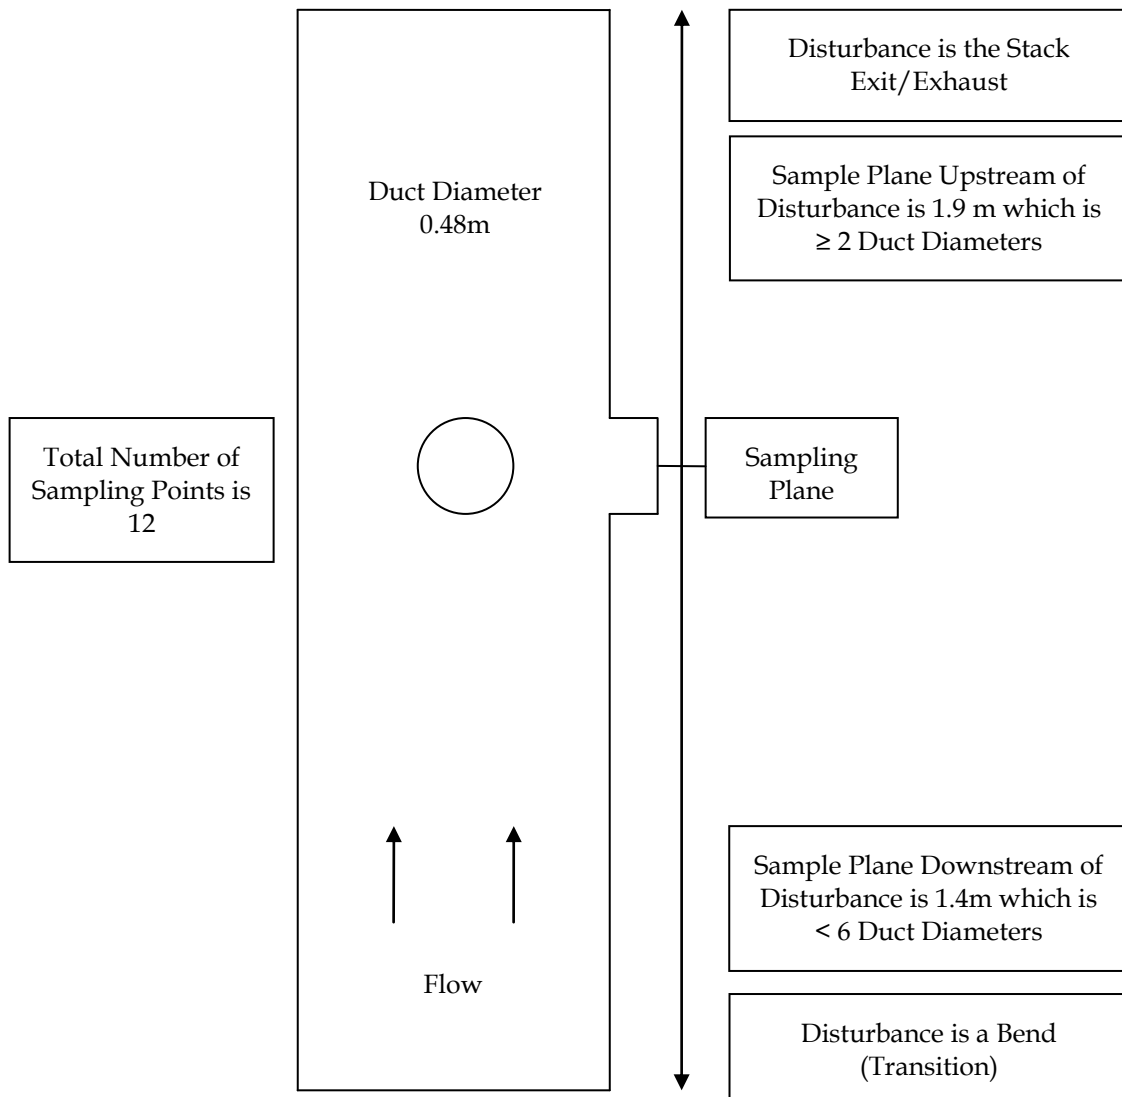

In the absence of cyclonic flow activity ideal sampling plane conditions will be found to exist at 6-8 duct diameters downstream and 2-3 duct diameters upstream from a flow disturbance. The sampling plane does not meet this criterion. Additional sample points were used in compliance with AS4323.1 as the sampling plane was non-ideal.

However the sample plane does meet the minimum sampling plane position; sampling plane conditions will be found to exist at 2 duct diameters downstream and 0.5 duct diameters upstream from a flow disturbance.

The location of the sampling plane complies with AS4323.1 temperature, velocity and gas flow profile criteria for sampling.